

# Installation Instruction

Product Code: JCEM110017WH

JCEM110017BLK

Product Description: EscapeLUX EM Bulkhead 1W 150lm 6K IP66

WH & BLK Self Test with legends

## Specification

Voltage:	AC220-240V
Input Power:	Max 3.5W
Emergency Power:	1W
Lumen:	150lm
Emergency Duration:	3 hours
Ambient Temp:	0-45°C
Emergency Mode:	Maintained/Non-Maintained
Function:	Self test / Manual test switchable
Battery:	LiFePO4 3.2V 1.5Ah
Warranty:	5 years





## Routine Testing

Testing should be carried out in accordance with the recommendations of BS5266 & EN50172.


1. Do not switch off unswitched mains supply after installation. If interruption is unavoidable, the batteries must be disconnected or damage to the batteries may occur. Leave the luminaire on continuous charge for 24 hours.
2. Batteries should be replaced when the luminaire no longer meets the 3 hours duration performance.
3. Testing is performed by interrupting the unswitched supply for the test duration manually or self-test function complying with IEC62034. During testing the luminaire should remain illuminated in emergency mode.
4. Ensure that the 'charge indicator' is 'ON' during 'Charging Mode'. If the charge indicator (LED) is Unlit/red, this signifies a fault.
5. Replace faulty light source and batteries immediately.

## Dimension

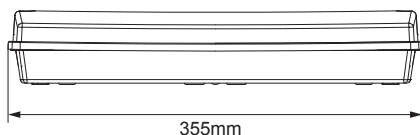


# Installation Instruction



1




ALWAYS SWITCH OFF THE MAINS SUPPLY BEFORE INSTALLATION OR SERVICING




2




3

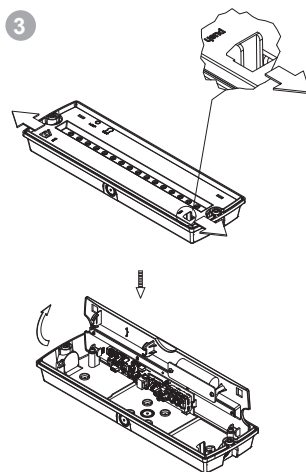


4

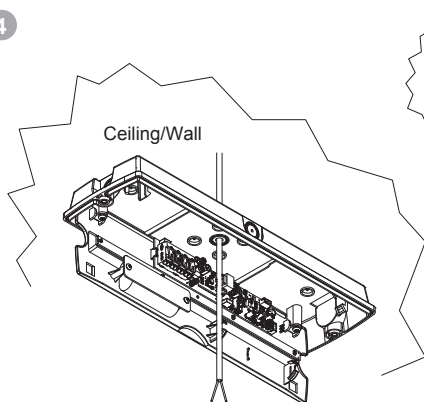

Ceiling/Wall




Drill hole in base tray  
Ø20mm




**Note: if using side entry: drill Ø20mm hole and apply PG13.5 cable gland (not supplied)**

**Side Entry**



Drill hole in side Ø20mm




PG13.5 cable gland


# Installation Instruction

5


## EMERGENCY TERMINATIONS NON-MAINTAINED




## EMERGENCY TERMINATIONS MAINTAINED




## EMERGENCY TERMINATIONS MAINTAINED (SWITCHABLE)




6

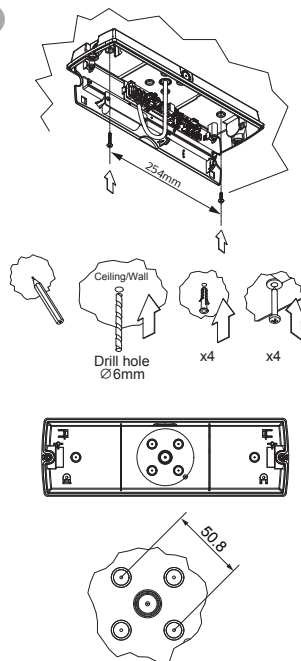

7

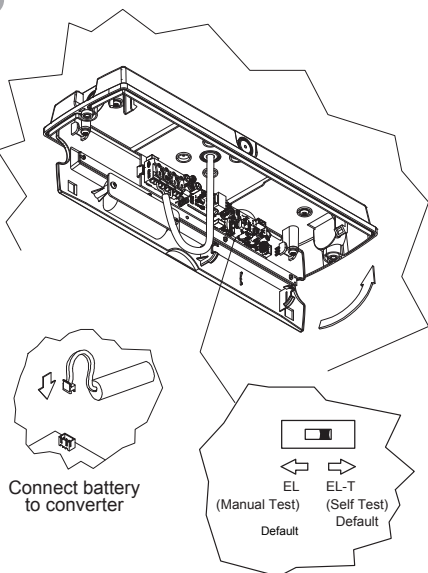


8

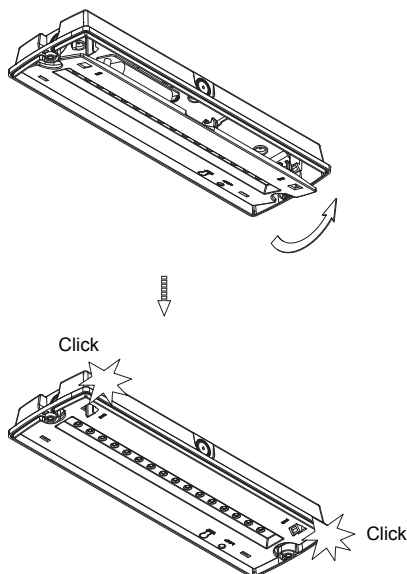


# Installation Instruction


9

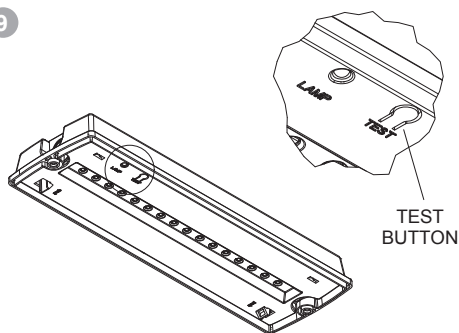


10

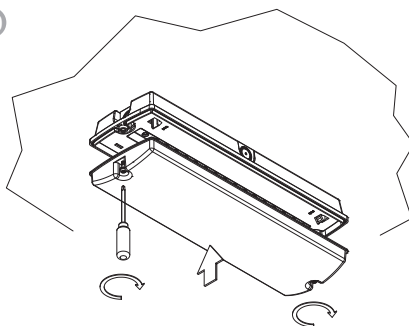

11

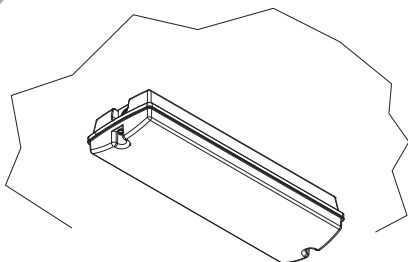


12




## Battery replacement


LiFePO<sub>4</sub>-18650-1500mAh-3.2V




Disconnect battery to converter



Remove the battery




Replace the battery



Connect new battery to converter

## Pictogram



# Specifications for Self Test

JCC

a LEVITON company

**Function Test**









The function test is carried out every week for 5 seconds. It will check the connection of battery, battery discharging and the connection of LED module.

**Duration Test**

An initial duration test is automatically carried out at first power on, but after 24 hours charging. After that, the duration test is carried out for 3 hours every half year, on one day within the 175th day to the 195th day. It will also check the connection of battery and LED module.

A bi-colour indicator will indicate the normal and abnormal status. Green is for conditions are normal and red for failures.

Descriptions as following.

LED Colour	Status		On Time (Seconds)	Off Time (Seconds)	Description
Green		Permanent on	/	/	Normal status when mains connected
		Slow flash	1s	1s	Duration test running
		Fast flash	0.2s	0.2s	Function test running
		Normal flash three times only	0.5s	0.5s	Time reset
Red		Permanent on	/	/	Battery failure
		Slow flash	1s	1s	Lamp failure
		Fast flash	0.2s	0.2s	Duration failure - battery capacity is not sufficient.
Light Off		Off	/	/	Emergency mode

A test switch is applied for different functions activated manually.

Duration	Function
Press for <2s	Simulate emergency mode
Press for 3-5s	Start duration test manually. The test can be aborted by pressing off (1-2s).
Press for 5-8s	Start Function test manually for 60s. The test can be aborted by pressing off (1-2s).
Press for >10s	Time Reset

**Note:**

- When the mains is on, the green indicator will be permanent on. It will check the connection of battery and the connection of LED module. When the mains is off, no test will perform.
- When there is a lamp failure at non-maintained mode, the indicator remains green but will turn red and be slow flashing after the failure is detected in a weekly function test.
- The luminaries on which we want to perform the duration tests must be connected to the mains supply for at least 24 uninterrupted hours.
- When the fault is corrected, the indicator will only be reset to its normal status after mains reconnected or test switch pressed.
- An accuracy of the timing of the test interval is ensured that it has an accuracy of  $\pm 75$  s per week. The timing function will be retained through periods of mains supply failure or interruption for up to 7 days.
- The battery charge shall not start if the cell temperature is below 0°C or above 65°C.